




Fire Hall # 1
2 Tolen Drive, Fort McMurray, AB
June 2-3, 2016
Fine Particulate Matter, PM2.5


— Hourly Concentration, ug/m3
- - - Ambient Air Quality Guideline, 80 ug/m3



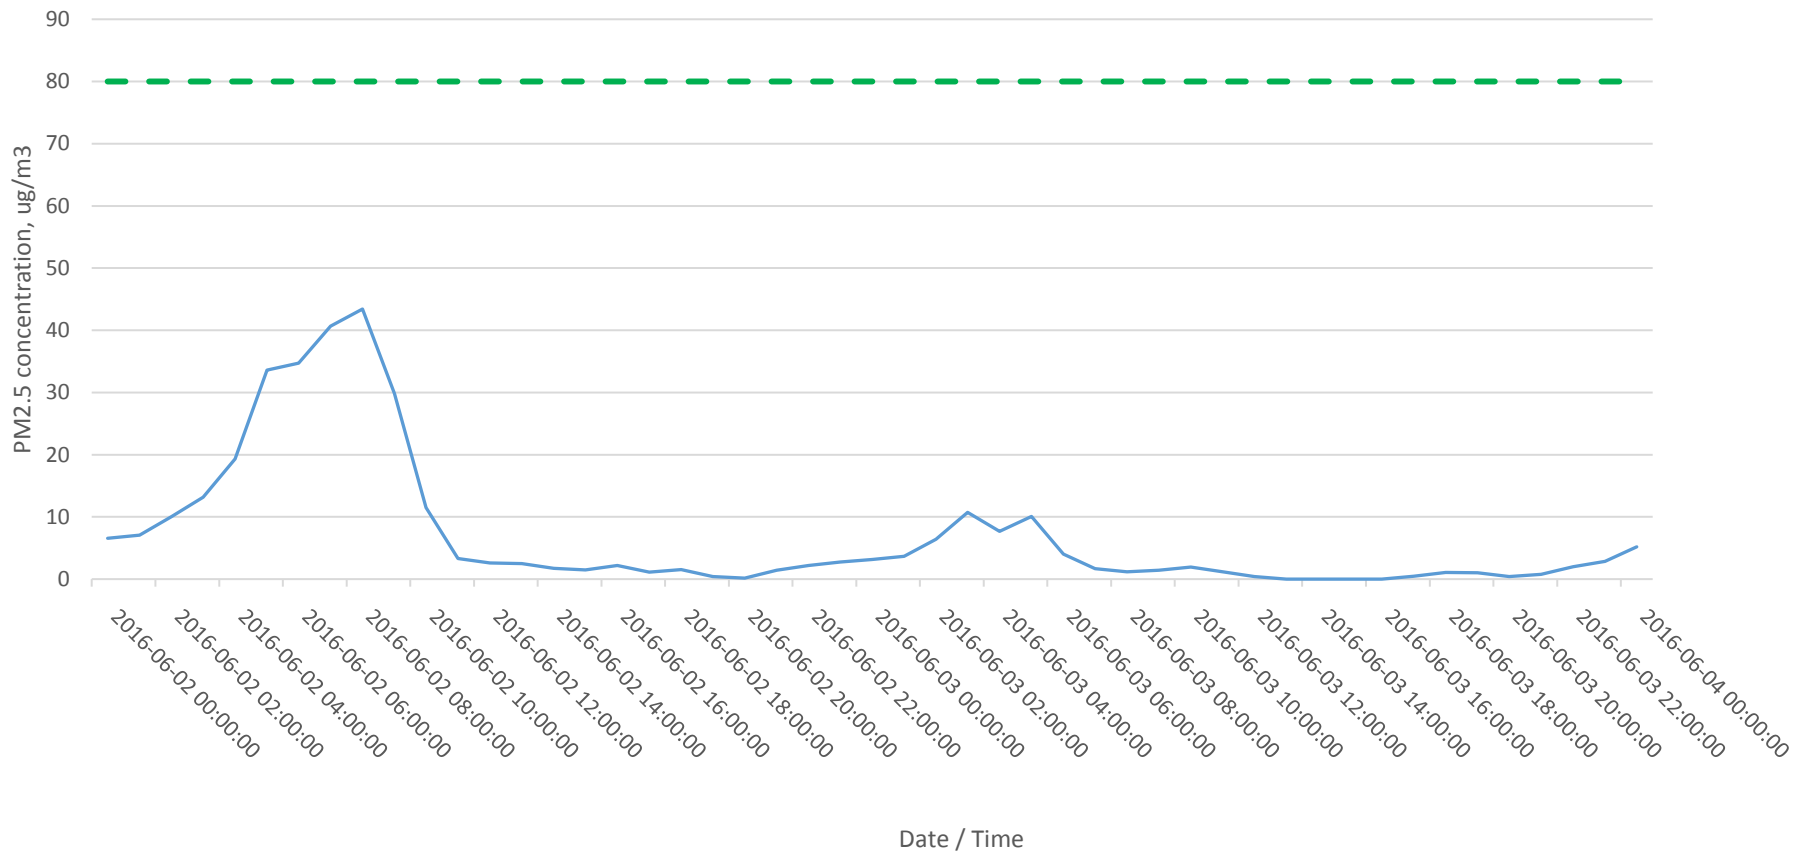

Fire Hall # 1
2 Tolen Drive, Fort McMurray, AB
June 2-3, 2016
Fine Particulate Matter, PM2.5

— Hourly Concentration, ug/m3
- - - Ambient Air Quality Guideline, 80 ug/m3

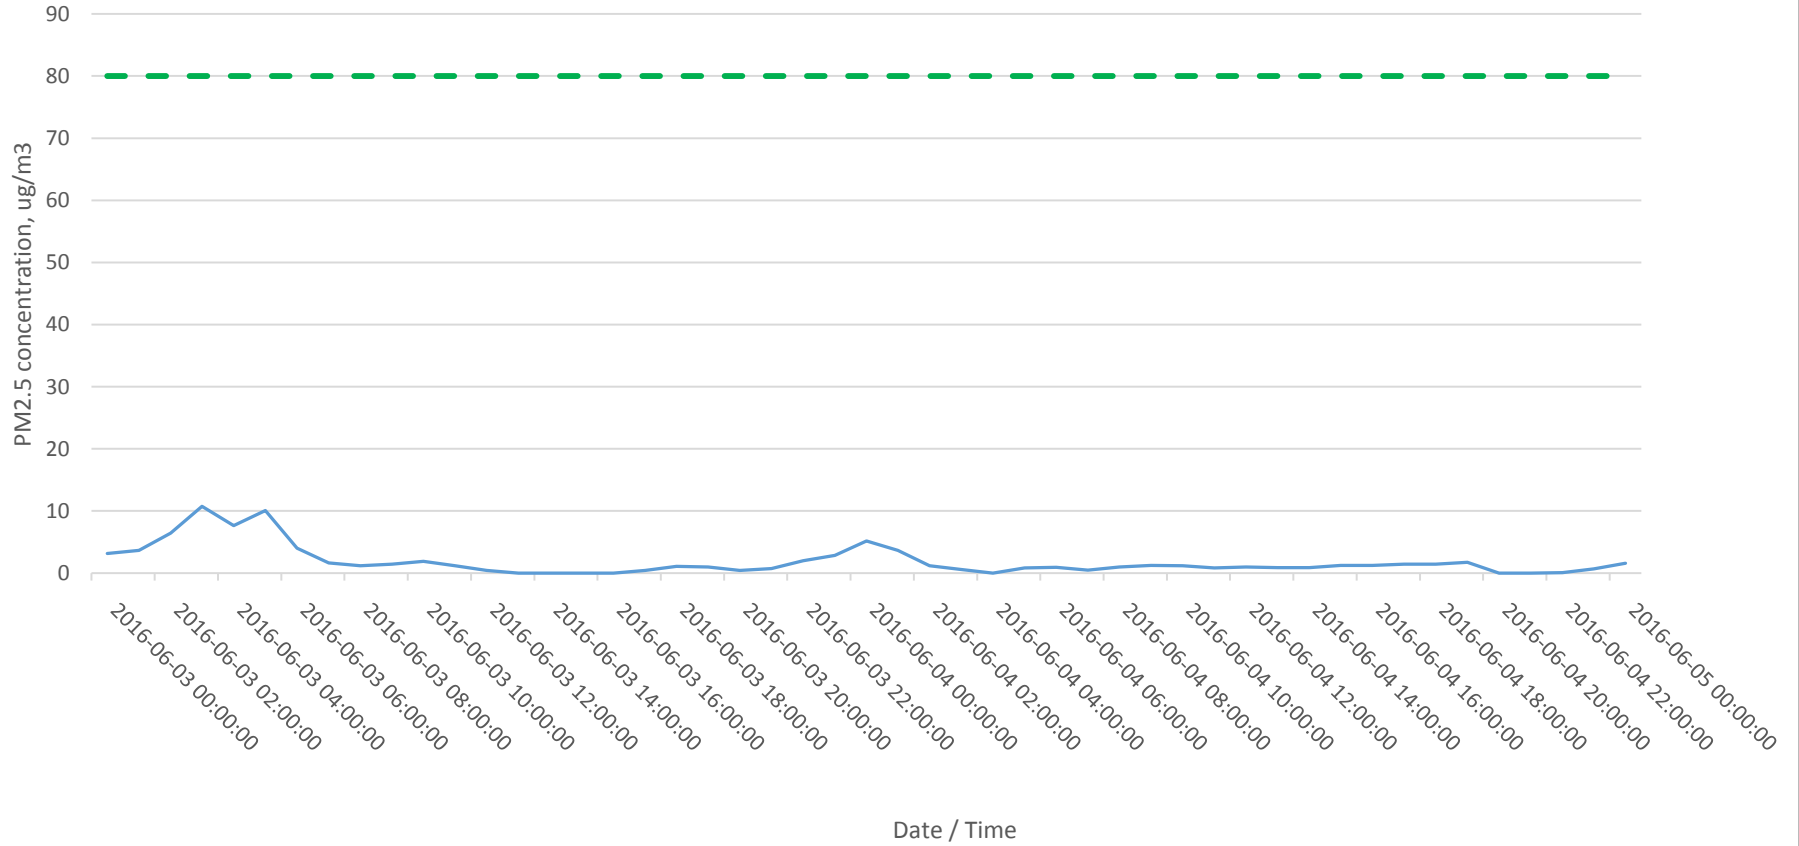



Fire Hall # 1
2 Tolen Drive, Fort McMurray, AB
June 4-5, 2016
Fine Particulate Matter, PM2.5

— Hourly Concentration, ug/m3
- - Ambient Air Quality Guideline, 80 ug/m3

